


JOINT TRENCH DETAIL OUTSIDE THE PUBLIC RIGHTS OF WAY

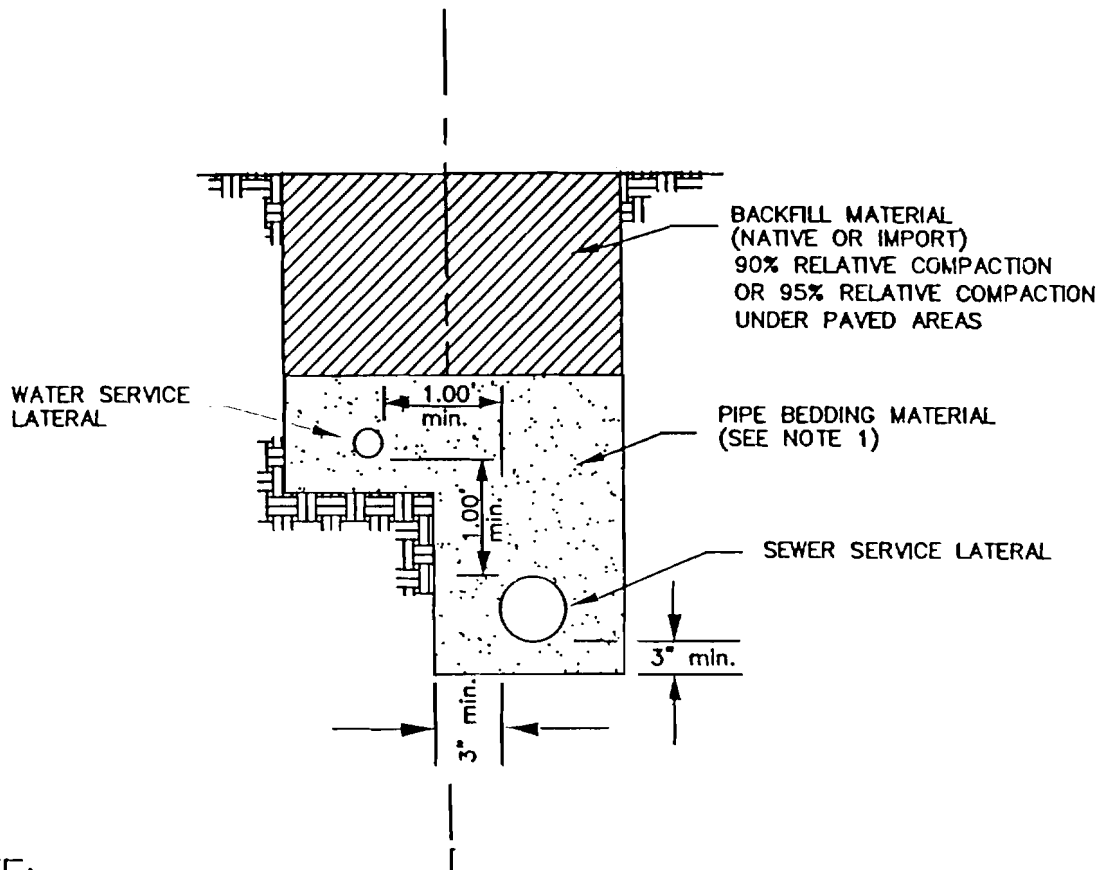

NOTE:

1. Pipe bedding material shall consist of either washed river sand, red lava sand or pea gravel. No white lava sand will be allowed.

CITY OF UKIAH

JOINT TRENCH DETAIL
WATER & SEWER SIDE SERVICES

SCALE: NONE

APPROVAL DATE:

DRAWN BY:

DATE: 6/5/96

APPROVED BY:

TGM

REVISED:

SHEET NO.:

DRAWING NO.: 222