


**NOTES:**

1. ALL METAL PARTS SHALL BE HOT DIPPED GALVANIZED AFTER FABRICATION, ASTM - A123.
2. CONCRETE SHALL TEST TO 3000 psi. AT 28 DAYS.
3. ALL REINFORCING SHALL BE 4x4-6-6 MESH.
4. REGARDLESS OF BASE WALL THICKNESS, HOLD THE INSIDE FACE OF BASE WALL 3" FROM TOP FACE OF CURB.
5. MAXIMUM GUTTER SLOPE WITHOUT UPSTREAM GALLEY IS 6%.
6. FOR BASE SECTION REFER TO STD. DRWG. NO. 408.
7. APPROVED CURB INLET MANUFACTURER(S) AND MODEL(S): SANTA ROSA CAST PRODUCT MODEL 2-1/2A

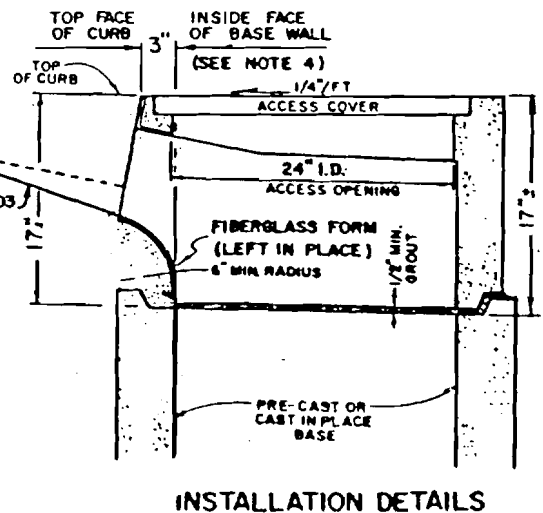

Scale: NO SCALE

**Drawn By:** ML

Approved By: 4/80

Drawing No.

Date: 3/17/87

Revised: 30/4

R. P. Schmitt

404